# A22TK



For full product information, visit www.sti.com. Use the SpeedSPEC Code for quick access to the specific web page.

# Safety Key Selector Switch

- · Key-type selector switch with direct opening mechanism
- Selector Switch for secure equipment activation during maintenance
- 30 types of exclusive keys make it more difficult to disable.
- The trapped key of the D4JL Guard Lock Safety-door Switch has the same shape as the locking key of the D4SL-SK10-LK Slide Key Unit. Units can be combined to improve safety. (Specify the same key type.)
- Common to the switch part of Emergency Stop Switch A22E. (Non-lighted model only)
- · A Rapid Delivery Product: Select models are available for shipment today or within 3 to 5 days











#### G **Ratings**

#### **Contacts (Standard Load)**

| Rated                   | Rated          | Rated current (A)           |                             |                             |                             |  |  |
|-------------------------|----------------|-----------------------------|-----------------------------|-----------------------------|-----------------------------|--|--|
| carry<br>current<br>(A) | voltage<br>(V) | AC15<br>(inductive<br>load) | AC12<br>(resistive<br>load) | DC13<br>(inductive<br>load) | DC12<br>(resistive<br>load) |  |  |
|                         | 24 VAC         | 10                          | 10                          |                             |                             |  |  |
|                         | 110 VAC        | 5                           | 10                          |                             |                             |  |  |
|                         | 220 VAC        | 3                           | 6                           |                             |                             |  |  |
|                         | 380 VAC        | 2                           | 3                           |                             |                             |  |  |
| 10                      | 440 VAC        | 1                           | 2                           |                             |                             |  |  |
|                         | 24 VDC         |                             |                             | 1.5                         | 10                          |  |  |
|                         | 110 VDC        |                             |                             | 0.5                         | 2                           |  |  |
|                         | 220 VDC        |                             |                             | 0.2                         | 0.6                         |  |  |
|                         | 380 VDC        |                             |                             | 0.1                         | 0.2                         |  |  |

- 1. Rated current values are determined according to the testing conditions. The above ratings were obtained by conducting tests under the following
  - (1) Ambient temperature: 20°±2°C
  - (2) Ambient humidity: 65±5%
- (3) Operating frequency: 20 operations/minute
- 2. Minimum applicable load: 10 mA at 5 VDC

#### Characteristics

| Item                      |  | A22TK  |  |
|---------------------------|--|--|--|
| Allowable operating       | Mechanical                               | 30 operations/minute max.                          |  |
| frequency                 | Electrical                               | 30 operations/minute max.                          |  |
| Insulation resistance     |  | 100 MΩ min. (at 500 VDC)                           |  |
| Dielectric strength       | Between<br>terminals of<br>same polarity | 2,500 VAC, 50/60 Hz for 1 min.                     |  |
| Dielectric strength       | Between each terminal and ground         | 2,500 VAC, 50/60 Hz for 1 min.                     |  |
| Vibration resistance *1   |  | 10 to 55 Hz, 1.5 mm double amplitude (within 1 ms) |  |
| Shock resistance          | Destruction                              | 1000 m/s <sup>2</sup>                              |  |
| SHOCK resistance          | Malfunction *1                           | 250 m/s <sup>2</sup> max.                          |  |
| Durability                | Mechanical                               | 100,000 operations min.                            |  |
| Durability                | Electrical                               | 100,000 operations min.                            |  |
| Ambient operating tem     | perature *2                              | -20 to +70°C                                       |  |
| Ambient operating hun     | nidity                                   | 35% to 85%RH                                       |  |
| Ambient storage temper    | erature                                  | -40 to +70°C                                       |  |
| Degree of protection      |  | IP65 *3  |  |
| Electric shock protection | on class                                 | Class II   |  |
| PTI (tracking character   | ristic)                                  | 175  |  |
| Degree of contamination   | on                                       | 3 (EN60947-5-1)                                    |  |

- \*1. Malfunction within 1 ms.
- \*2. With no icing or condensation.
- \*3. The degree of protection from the front of the panel.
- Note: 1. Do not allow the load current to exceed the rated value.
  - 2. The contact ON/OFF timing is not synchronized. Confirm performance before application.
  - 3. Once the contacts have been used to switch a load, however, they cannot be used to switch smaller loads. The contact surfaces will become rough once they have been used and contact reliability for smaller loads may be reduced.



Select models are available for Rapid Delivery.





# **Specifications (continued)**

#### **Characteristics**


| Item                            |                                    | A22TK  |  |
|---------------------------------|------------------------------------|--|--|
| Allowable operating             | Mechanical                         | 30 operations/minute max.                          |  |
| frequency                       | Electrical                         | 30 operations/minute max.                          |  |
| Insulation resistance           |                                    | 100 MΩ min. (at 500 VDC)                           |  |
| Diologatria atronath            | Between terminals of same polarity | 2,500 VAC, 50/60 Hz for 1 min.                     |  |
| Dielectric strength             | Between each terminal and ground   | 2,500 VAC, 50/60 Hz for 1 min.                     |  |
| Vibration resistance *1         |                                    | 10 to 55 Hz, 1.5 mm double amplitude (within 1 ms) |  |
| Shock resistance                | Destruction                        | 1000 m/s <sup>2</sup>                              |  |
| SHOCK resistance                | Malfunction *1                     | 250 m/s² max.                                      |  |
| Durahilitu                      | Mechanical                         | 100,000 operations min.                            |  |
| Durability                      | Electrical                         | 100,000 operations min.                            |  |
| Ambient operating temperatu     | re *2                              | -20 to +70°C                                       |  |
| Ambient operating humidity      |                                    | 35% to 85%RH                                       |  |
| Ambient storage temperature     | ,                                  | -40 to +70°C                                       |  |
| Degree of protection            |                                    | IP65 *3  |  |
| Electric shock protection class |                                    | Class II   |  |
| PTI (tracking characteristic)   |                                    | 175  |  |
| Degree of contamination         |                                    | 3 (EN60947-5-1)                                    |  |

- \*1. Malfunction within 1 ms.
- \*2. With no icing or condensation.
- \*3. The degree of protection from
- the front of the panel.

  Note: 1. Do not allow the load current to exceed the rated value.
  - 2. The contact ON/OFF timing is not synchronized.
    Confirm performance before application.
  - 3. Once the contacts have been used to switch a load, however, they cannot be used to switch smaller loads. The contact surfaces will become rough once they have been used and contact reliability for smaller loads may be reduced.


**Dimensions** (mm)





#### A22TK-2RL











# Wiring

#### **Contact Configuration**

#### A22TK-2□L


| Key position | SPST-NC      | SPST-NO/SPST-NC      | DPST-NC            | DPST-NC + SPST-NO                    | DPST-NO + SPST-NO  | TPST-NC         |
|--------------|--------------|----------------------|--------------------|--------------------------------------|--|-----------------|
| $\bigcirc$   | • . •        | 0 0 0                | • • • • •          | • • • • • • •                        | 0 0 0 0 0 0  | • • • • • • • • |
| $\bigcirc$   | <u>• , •</u> | <del>0 0</del> ● ₁ ● | <u>• . • • . •</u> | • •_ • • • • • • • • • • • • • • • • | <del>0 0 0 0 0 0 0</del> <b>0 0 0 0 0 0 0 0 0 0 0 0 </b> | • • • • • •     |

#### A22TK-2□R

| Key position | SPST-NC          | SPST-NO/SPST-NC      | DPST-NC          | DPST-NC + SPST-NO                     | DPST-NO + SPST-NO      | TPST-NC         |
|--------------|------------------|----------------------|------------------|---------------------------------------|------------------------|-----------------|
| $\bigcirc$   | <u>•        </u> | <del>0 0</del> • • • | • • • • •        | • • • • • • • • • • • • • • • • • • • | <del>0 0 0 0 • •</del> | • • • • • • •   |
| $\bigcirc$   | • - •            | 0 0                  | <u>• • • • •</u> | • • • • • • •                         | 0 0 0 0 0 0            | • • • • • • • • |


#### **Operation Angle**

G



FP: Free position TTP: Total travel position

#### **Terminal Arrangement (Bottom View)**

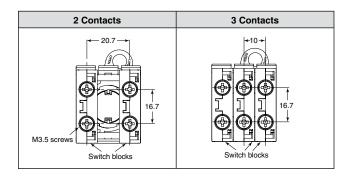

In such case, contacts will not work as shown in the table above. Make sure to shift the key to the FP or TTP position to ensure contact switching and meet the direct opening operation characteristic.

#### **Terminal Connection**

| Time        | Terminal connection (Bottom View) |     |         |     |                   |                   |         |
|-------------|-----------------------------------|-----|---------|-----|-------------------|-------------------|---------|
| Туре        | SPST-NO/SPST-NC                   |     | DPST-NC |     | DPST-NC + SPST-NO | DPST-NO + SPST-NC | TPST-NC |
| Non-lighted | 1 2                               | 3 4 | 1 2     | 1 2 | ① ① ③             | ① ③ ③             | ©       |

Select models are available for Rapid Delivery.






<sup>\*</sup>The key stops between FP and TTP.

## **Application Example**


G9SX-BC: Manual reset, cross fault detection: ON (category 4 wiring)

G9SX-GS: Manual reset, cross fault detection: ON (category 4 wiring), logical AND connection setting: AND

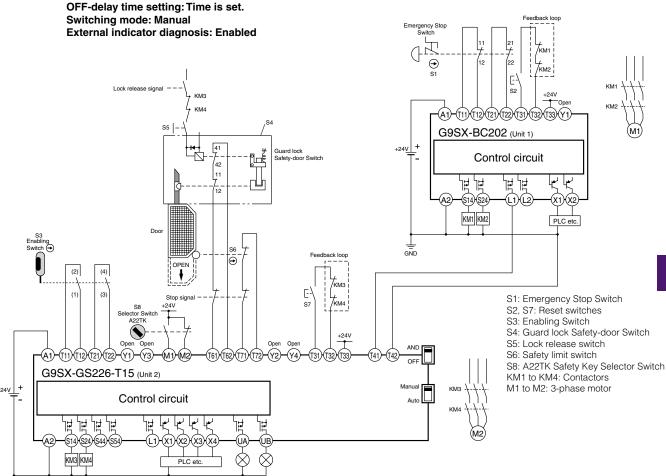

#### **Timing Chart**

± GND

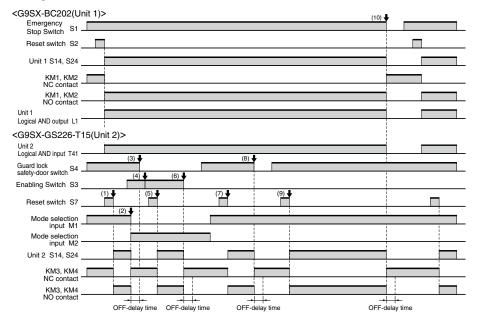

Indicator

(Diagnostic check enabled)

Indicator

(Diagnostic check enabled)

- (1) The G9SX-GS starts in operation mode.
- (2) The mode switches to maintenance mode.
- (3) The operator opens the door and performs maintenance work.
- (4) The Enabling Switch is gripped to the middle position.
- (5) The G9SX-GS starts in maintenance mode.
- (6) The G9SX-GS will stop when the Enabling Switch is released or gripped.
- (7) The G9SX-GS will start again after the door is closed and the mode is switched to operation mode.
- (8) The G9SX-GS will stop when the door is open while in operation mode.
- (9) The door is closed and the G9SX-GS starts again.
- (10) All the units will stop if the emergency stop is pressed.





# **Ordering**

#### Model Number Structure (Ordering as a set)

The operation unit and switch are delivered as a set. For information on combinations, refer to "List of Models"

A22TK − □ - □ - □ □

0 0 0 0

Operation Unit

| Symbol | No. of notches | Key release position | Key position of NC contact closing |
|--------|----------------|----------------------|------------------------------------|
| 2LL    |                | $\bigcirc$           | $\bigcirc$                         |
| 2RL    |                | <b>Ø</b>             | $\bigcirc$                         |
| 2LR    | 2              | $\bigcirc$           | $\bigcirc$                         |
| 2RR    |                | <b>Ø</b>             | <b>Ø</b>                           |

2 Contact Configuration

01: SPST-NC

11: SPST-NO/SPST-NC

02: DPST-NC

12: DPST-NC + SPST-NO

21: DPST-NO + SPST-NC

03: TPST-NC

8 Key Availability None: No Key K: With Key

4 Key Type 01 to 30: 30 Types\* \*Key can be created up to 30 types. Specify keys in order, starting from 01.

G

#### **Base Models**

| Model            | Description  |
|------------------|--|
| A22TK-2LL-02-K01 | A22TK Base Model, 2 N/C, Left Key Release, Left N/C Closed, Key Included             |
| A22TK-2LR-12-K01 | A22TK Base Model, 1 N/O + 2 N/C, Left Key<br>Release, Right N/C Closed, Key Included |
| A22TK-2RL-02-K01 | A22TK Base Model, 2 N/C, RIGHT Key Release,<br>Left N/C Closed, Key Included         |
| A22TK-2RL-12-K01 | A22TK Base Model, 1 N/O +2 N/C, Right Key<br>Release, Left N/C Closed, Key Included  |

#### **Accessories**

| Name        | Appearance | Classification                               | Model      | Remarks                       |
|-------------|------------|--|------------|-------------------------------|
| Control Box |            | One hole, yellow box<br>(for emergency stop) | A22Z-B101Y | Material: Polycarbonate resin |

\*For information on two-hole and three-hole control boxes, contact your Omron representative. Also, a Switch Block, Mounting Latch, Connector, and Lock Plate can be used.

(Continued on next page)



Select models are available for Rapid Delivery.





# **Ordering (continued)**

### **List of Models (Completely Assembled)**

Shipped as a set which includes the Operation Unit and Switch. For the model with Operation Unit only, contact your Omron representative.

| Appearance | Key release position | Key position of NC contact closing | Contact Configuration | Key<br>availability | Model            |
|------------|----------------------|------------------------------------|-----------------------|---------------------|------------------|
|            |                      |                                    | SPST-NC               |                     | A22TK-2LL-01-K01 |
|            | _                    |                                    | SPST-NO/SPST-NC       |                     | A22TK-2LL-11-K01 |
|            |                      |                                    | DPST-NC               |                     | A22TK-2LL-02-K01 |
|            |                      |                                    | DPST-NC + SPST-NO     |                     | A22TK-2LL-12-K01 |
|            |                      |                                    | DPST-NO + SPST-NC     |                     | A22TK-2LL-21-K01 |
|            |                      |                                    | TPST-NC               |                     | A22TK-2LL-03-K01 |
|            |                      |                                    | SPST-NC               |                     | A22TK-2RL-01-K01 |
|            | _                    |                                    | SPST-NO/SPST-NC       |                     | A22TK-2RL-11-K01 |
|            |                      |                                    | DPST-NC               |                     | A22TK-2RL-02-K01 |
|            |                      |                                    | DPST-NC + SPST-NO     |                     | A22TK-2RL-12-K01 |
|            |                      |                                    | DPST-NO + SPST-NC     |                     | A22TK-2RL-21-K01 |
|            |                      |                                    | TPST-NC               | .,                  | A22TK-2RL-03-K01 |
|            |                      |                                    | SPST-NC               | Yes                 | A22TK-2LR-01-K01 |
|            |                      |                                    | SPST-NO/SPST-NC       |                     | A22TK-2LR-11-K01 |
|            |                      |                                    | DPST-NC               |                     | A22TK-2LR-02-K01 |
|            |                      |                                    | DPST-NC + SPST-NO     |                     | A22TK-2LR-12-K01 |
| ( inc      | •                    |                                    | DPST-NO + SPST-NC     |                     | A22TK-2LR-21-K01 |
|            |                      |                                    | TPST-NC               |                     | A22TK-2LR-03-K01 |
|            |                      |                                    | SPST-NC               |                     | A22TK-2RR-01-K01 |
|            | $\bigcirc$           |                                    | SPST-NO/SPST-NC       |                     | A22TK-2RR-11-K01 |
|            |                      |                                    | DPST-NC               |                     | A22TK-2RR-02-K01 |
|            |                      | (/)                                | DPST-NC + SPST-NO     |                     | A22TK-2RR-12-K01 |
|            |                      |                                    | DPST-NO + SPST-NC     |                     | A22TK-2RR-21-K01 |
|            |                      |                                    | TPST-NC               |                     | A22TK-2RR-03-K01 |
|            |                      |                                    | SPST-NC               |                     | A22TK-2LL-01-01  |
|            |                      |                                    | SPST-NO/SPST-NC       |                     | A22TK-2LL-11-01  |
|            | (3)                  |                                    | DPST-NC               |                     | A22TK-2LL-02-01  |
|            |                      |                                    | DPST-NC + SPST-NO     |                     | A22TK-2LL-12-01  |
|            |                      |                                    | DPST-NO + SPST-NC     |                     | A22TK-2LL-21-01  |
|            |                      |                                    | TPST-NC               |                     | A22TK-2LL-03-01  |
|            |                      |                                    | SPST-NC               |                     | A22TK-2RL-01-01  |
|            |                      |                                    | SPST-NO/SPST-NC       |                     | A22TK-2RL-11-01  |
|            |                      |                                    | DPST-NC               |                     | A22TK-2RL-02-01  |
|            | (/)                  |                                    | DPST-NC + SPST-NO     |                     | A22TK-2RL-12-01  |
|            | <u> </u>             |                                    | DPST-NO + SPST-NC     |                     | A22TK-2RL-21-01  |
|            |                      |                                    | TPST-NC               |                     | A22TK-2RL-03-01  |
|            |                      |                                    | SPST-NC               | No                  | A22TK-2LR-01-01  |
|            |                      |                                    | SPST-NO/SPST-NC       |                     | A22TK-2LR-11-01  |
|            |                      |                                    | DPST-NC               |                     | A22TK-2LR-02-01  |
|            | $(\ \ \ )$           | (/)                                | DPST-NC + SPST-NO     |                     | A22TK-2LR-12-01  |
|            |                      |                                    | DPST-NO + SPST-NC     |                     | A22TK-2LR-21-01  |
|            |                      |                                    | TPST-NC               |                     | A22TK-2LR-03-01  |
|            |                      |                                    | SPST-NC               |                     | A22TK-2ER-01-01  |
|            |                      |                                    | SPST-NO/SPST-NC       |                     | A22TK-2RR-11-01  |
|            |                      |                                    | DPST-NC               |                     | A22TK-2RR-02-01  |
|            | ( / )                | ( / )                              | DPST-NC + SPST-NO     |                     | A22TK-2RR-02-01  |
|            |                      |                                    |                       | mark partification  |                  |
|            |                      |                                    | DPST-NO + SPST-NC     |                     | A22TK-2RR-21-01  |
|            |                      |                                    | TPST-NC               |                     | A22TK-2RR-03-01  |

Note: Omron will obtain the S-mark certification for the models above. For information on other models, contact your Omron representative.





