
3100 SERIES LOW PROFILE CONNECTOR FOR PREVENTING EMI

General

The 3100 series low profile I/O connectors for preventing EMI are perfect for today's compact electronic equipment. Available in 6, 8, 12, 14 and 16 pins.

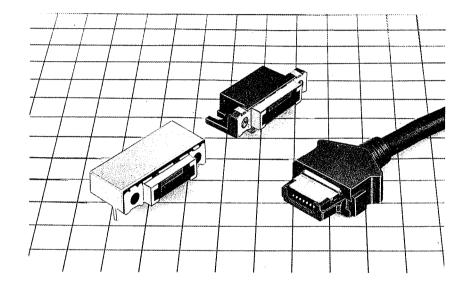

Features

- The metal shell guide structure for the receptacle connector reduces drastically the height for the substrate to 7mm.
- (2) The metal shell with a molded cover case is designed to shield it from electrostatic discharge (ESD).
- (3) The cantilever profile of the female contact ensures effortless coupling and long service life.
- (4) The effective engagement length is of sequence structure and sufficient to allow the shielded part to engage first when connecting.
- (5) The cable can be terminated efficiently just by crimping with a jig after passing the cable through the guide plate hole.
- (6) Cables AWG 26 to AGW 30 are applicable by partially changing the guide plate since the male cnnoector adopts a U-slit type connection.
- (7) The side latching method of the molded cover assures easy locking of the plug connector.

Application

Office Automation, Communications, Home Automation and Other equipment.


Specification

Specification					
Current capacity	0.5A				
Rated Voltage	AC 125V				
Insulation Resistance	Min. 250MΩ at DC 100V				
Contact Resistance	Max. 35mΩ at DC 1mA				
Withstanding Voltage	AC 300Vr.m.s for 1 minute				


Relation betwee	en guide plate and	applicable coating	O.D.
Hole dia (mm) of Wire Configuration Gulde Plate	¢ 0.65	¢ 0.85	φ 1
Applicable Cable Cut dia (mm)	¢ 0.57∼ ¢ 0.63	∲ 0.75∼ ∲ 0.8 3	¢ 0.88∼ ¢ 0.98

Material & Finish


		Material Finish	
	Insulation	PBT resin	Black UL94V-0
Receptacle Contact Shell	Contact	Brass	Selective gold plating
	Brass	Solder plating	
	Insulation Polycarbonate Besin		White for AWG #28
	msulation	Insulation Polycarbonate Resin	Black for AWG #30
Plug	Contact	Brass	Selective gold plating
Guid	Guide Plate	Polycarbonate resin	Transparent
	Shell	Brass	Solder plating
	Cover	Polycarbonate resin	

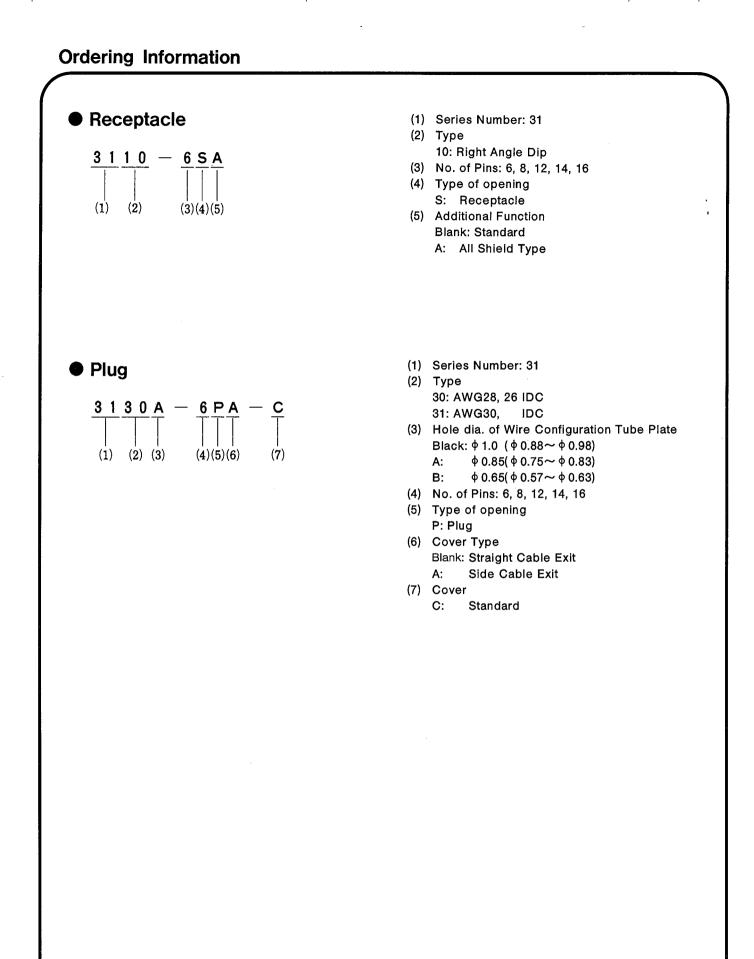

Receptacle (Standard)

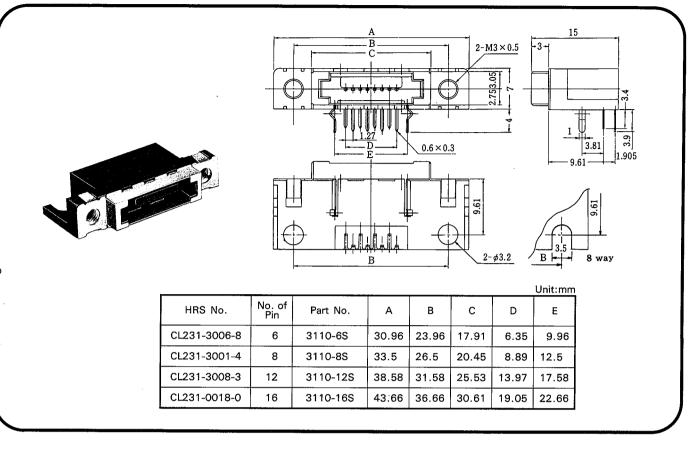



Receptacle (All Shielded Type)

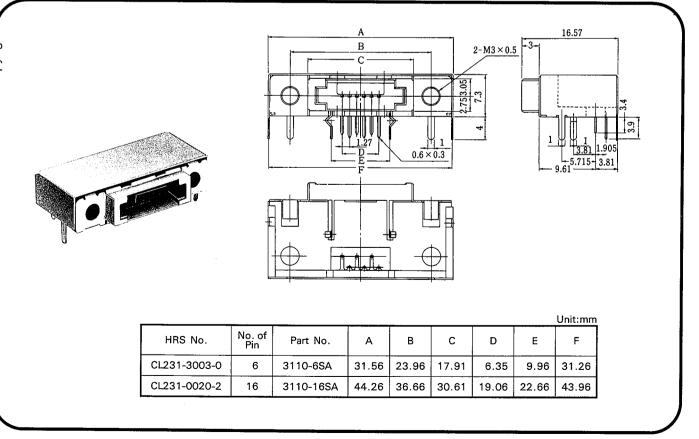


Aug.1.2022 Copyright 2022 HIROSE ELECTRIC CO., LTD. All Rights Reserved. Nov.1.2016 Copyright 2016 HIROSE ELECTRIC CO., LTD. All Rights Rese

Receptacle (Without Mounting Hole Type)




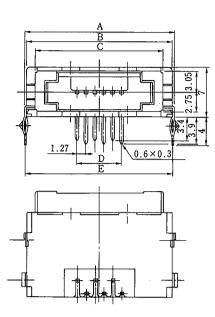




							Unit (mm)
HRS No.	No. of pin	Parts No.	А	В	с	D	E
CL231-3017-4	6	31 10- 6SB	20.86	20.26	17.91	6.35	20.56
CL231-0021-5	14	3110-14SB	31.02	30.42	28.07	16.51	30.72

Plug (Straight Cable Exit Type)

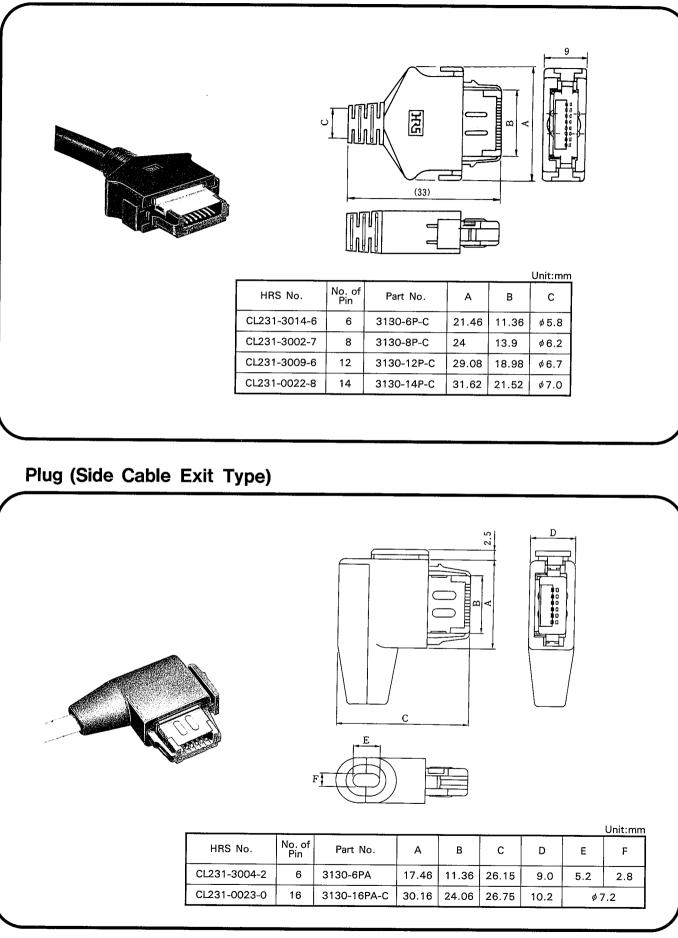


Panel Cutout (Thickness of Panel:Max.1.6mm)

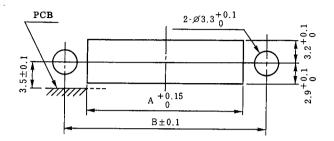

				Unit: mm
HRS No.	No. of Pin	Part No.	A	в
CL231-3006-8	6	3110- 6S	18.06	23.96
CL231-3001-4	8	3110- 8S	20.6	26.5
CL231-3008-3	12	3110-12S	25.68	31.58
CL231-0018-0	16	3110-16S	30.76	36.66
CL231-0021-5	14	3110-14SB	28.22	-


Coupling Status

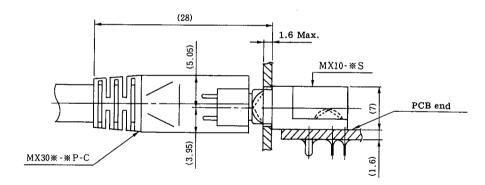

Note: Screw for Panel: M3 x 0.5 length 6 mm.


Backboard Pattern



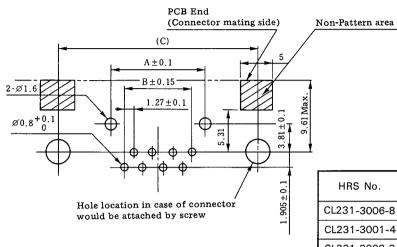

				ı	Jnit:mm
HRS No.	No. of Pin	Part No.	А	в	с
CL231-3006-8	6	3110-6S	9.96	6.35	23.96
CL231-3001-4	8	3110-8S	12.5	8.39	26.5
CL231-3008-3	12	3110-12S	17.58	13.97	31.58
CL231-0018-0	16	3110-16S	22.66	19.05	36.66


(All Shielded Type)

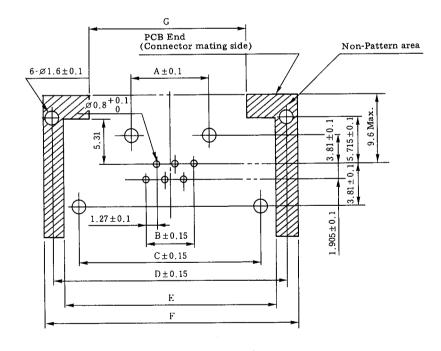

								, l	<u>Jnit:mm</u>
HRS No.	No. of Pin	Part No.	А	В	с	D	Е	F	G
CL231-3003-0	6	3110-6SA	9.96	6.35	23.96	31.26	27.56	31.96	18.96
CL231-0020-2	16	3110-16SA	22.66	19.05	36.66	43.96	40.26	44.66	31.66

Aug.1.2022 Copyright 2022 HIROSE ELECTRIC CO., LTD. All Rights Reserved. Nov.1.2016 Copyright 2016 HIROSE ELECTRIC CO., LTD. All Rights Reserved.

(Without Mounting Hole Type)

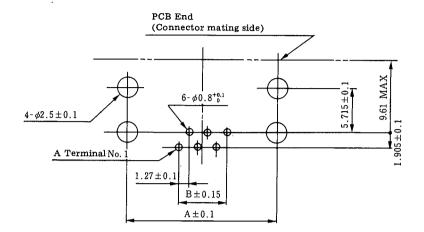

0			l	Jnit:mm
HRS No.	No. of Pin	Part No.	А	В
CL231-3017-4	6	3110-6SB	20.56	6.35
CL231-0021-5	14	3110-14SB	30.72	16.51

Connecting Method

Specification	Procedure	Specification
Peel the shielded braid and terminate treatment.	4. IDC	Insert the guide plate into the plug temporarily and press it.
(5) Molded cover		Pre-Insertion
	E. Covering and	
to the corresponding guide plate.	clamping	Cover the ground plate B and fasten the cable by clamping.
all old Hole dia. indication		Clamp
Cut the remaining part of the wire and clamp the cable conductor.	6. Covering	
Crimped connection		
	Peel the shielded braid and terminate treatment.	Peel the shielded braid and terminate treatment. 4. IDC Image: Construction of the corresponding guide plate. 5. Covering and clamping Image: Construction of the corresponding part of the wire and clamp the cable conductor. 6. Covering Cut the remaining part of the wire and clamp the cable conductor. 6. Covering

 $\left(\right)$

Tooling

Connector	Process	Tool Na	ame
3130–6P–-C	Wire clamp Remaining part of cable cut		3130—6CT
	Crimping, Clamp		3130—6GP
3130–8P–C	Wire clamp Remaining part of cable cut		3130—8CT
	Crimping, Clamp	Hi-Flex	3130–8GP
313012PC	Wire clamp Remaining part of cable cut	Connecting press	3130–12CT
3130-128-0	Crimping, Clamp		3130–12GP
3130-14P-C	Wire clamp Remaining part of cable cut		3130–14CT
3130-142-0	Crimping, Clamp		3130–14GP

(Side Cable Exit Type)

Connector	Process	Tool Name	
3130—6PA	Wire clamp Remaining part of cable cut		3130–6CT–A
3130-01 A	Crimping, Clamp	Hi-Flex	3130-6GP-A
3130—16PA—C	Wire clamp Remaining part of cable cut	Connecting press (CL550—0082—2)	313016CTA
5130-16PA-C	Crimping, Clamp		3130—16GP—A